


SECTION B-B

SECTION A-A

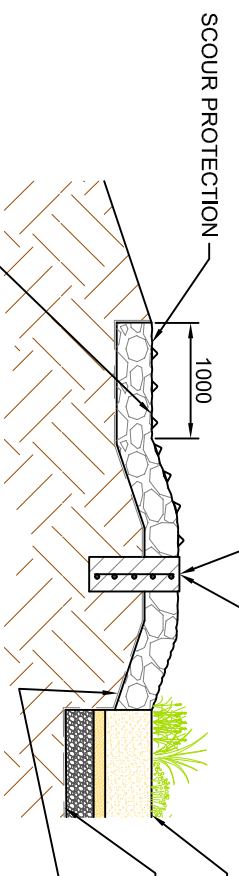

ENERGY DISSIPATION MEASURES

- NOTES**
1. REFER TO WATER CYCLE MANAGEMENT GUIDELINES AND SOID GUIDELINES FOR DESIGN GUIDANCE
 2. ENGINEERING WORKS TO BE DESIGNED IN ACCORDANCE WITH COUNCIL'S ENGINEERING DESIGN GUIDELINES
 3. CONCRETE APRON TO BE 25MPA WITH SL82 REINFORCING STEEL AND 150mm MINIMUM THICKNESS
 4. ROCK FOR APRON STONE PITCHING TO BE 250-300mm HARD DURABLE ROCK IN ACCORDANCE WITH ENGINEERING GUIDELINES

DRAWING DETAIL BASED ON THE INSTITUTE OF PUBLIC WORKS ENGINEERING AUSTRALIA QUEENSLAND DIVISION INC. STANDARD DRAWINGS

| | | |
|---------|------------|-------------------------------|
| 04 | 6 AUG 16 | REVISED NOTES |
| 03 | 11 DEC 13 | REVISED NOTES |
| 02 | 27 SEPT 12 | REMOVE BUND FROM SECTION VIEW |
| 01 | 22 JUNE 12 | DRAFT ISSUE |
| VERSION | DATE | COMMENTS |

WORK TO FIGURED DIMENSIONS - DO NOT SCALE - THIS DRAWING IS SUBJECT TO COPYRIGHT AND IS THE PROPERTY OF LAKE MACQUARIE CITY COUNCIL. PERSONS MUST NOT RELY ON THESE STANDARD DRAWINGS AS THE EQUIVALENT OF OR A SUBSTITUTE FOR PROJECT-SPECIFIC DESIGN & ASSESSMENT BY A QUALIFIED PROFESSIONAL.



126-138 MAIN ROAD
SPEERS POINT
PHONE (02)4921 0333
www.lakemac.com.au

DRAWING TITLE
HIGH FLOW WEIR DETAILS

SHEET: 1 OF 1
DRAWING No: EGSD-419
VERSION: 4